



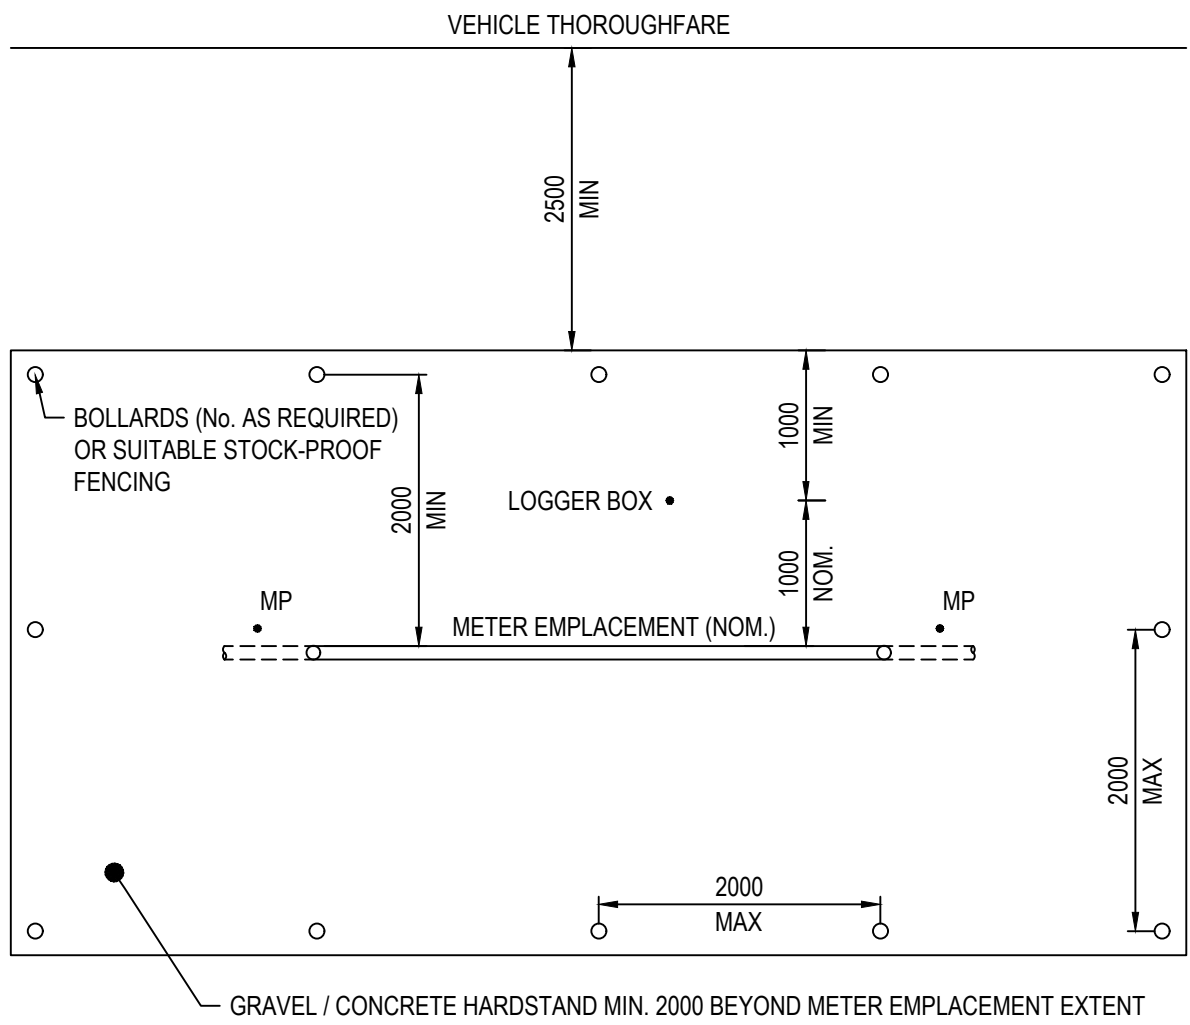

SITE PLAN
NOT TO SCALE

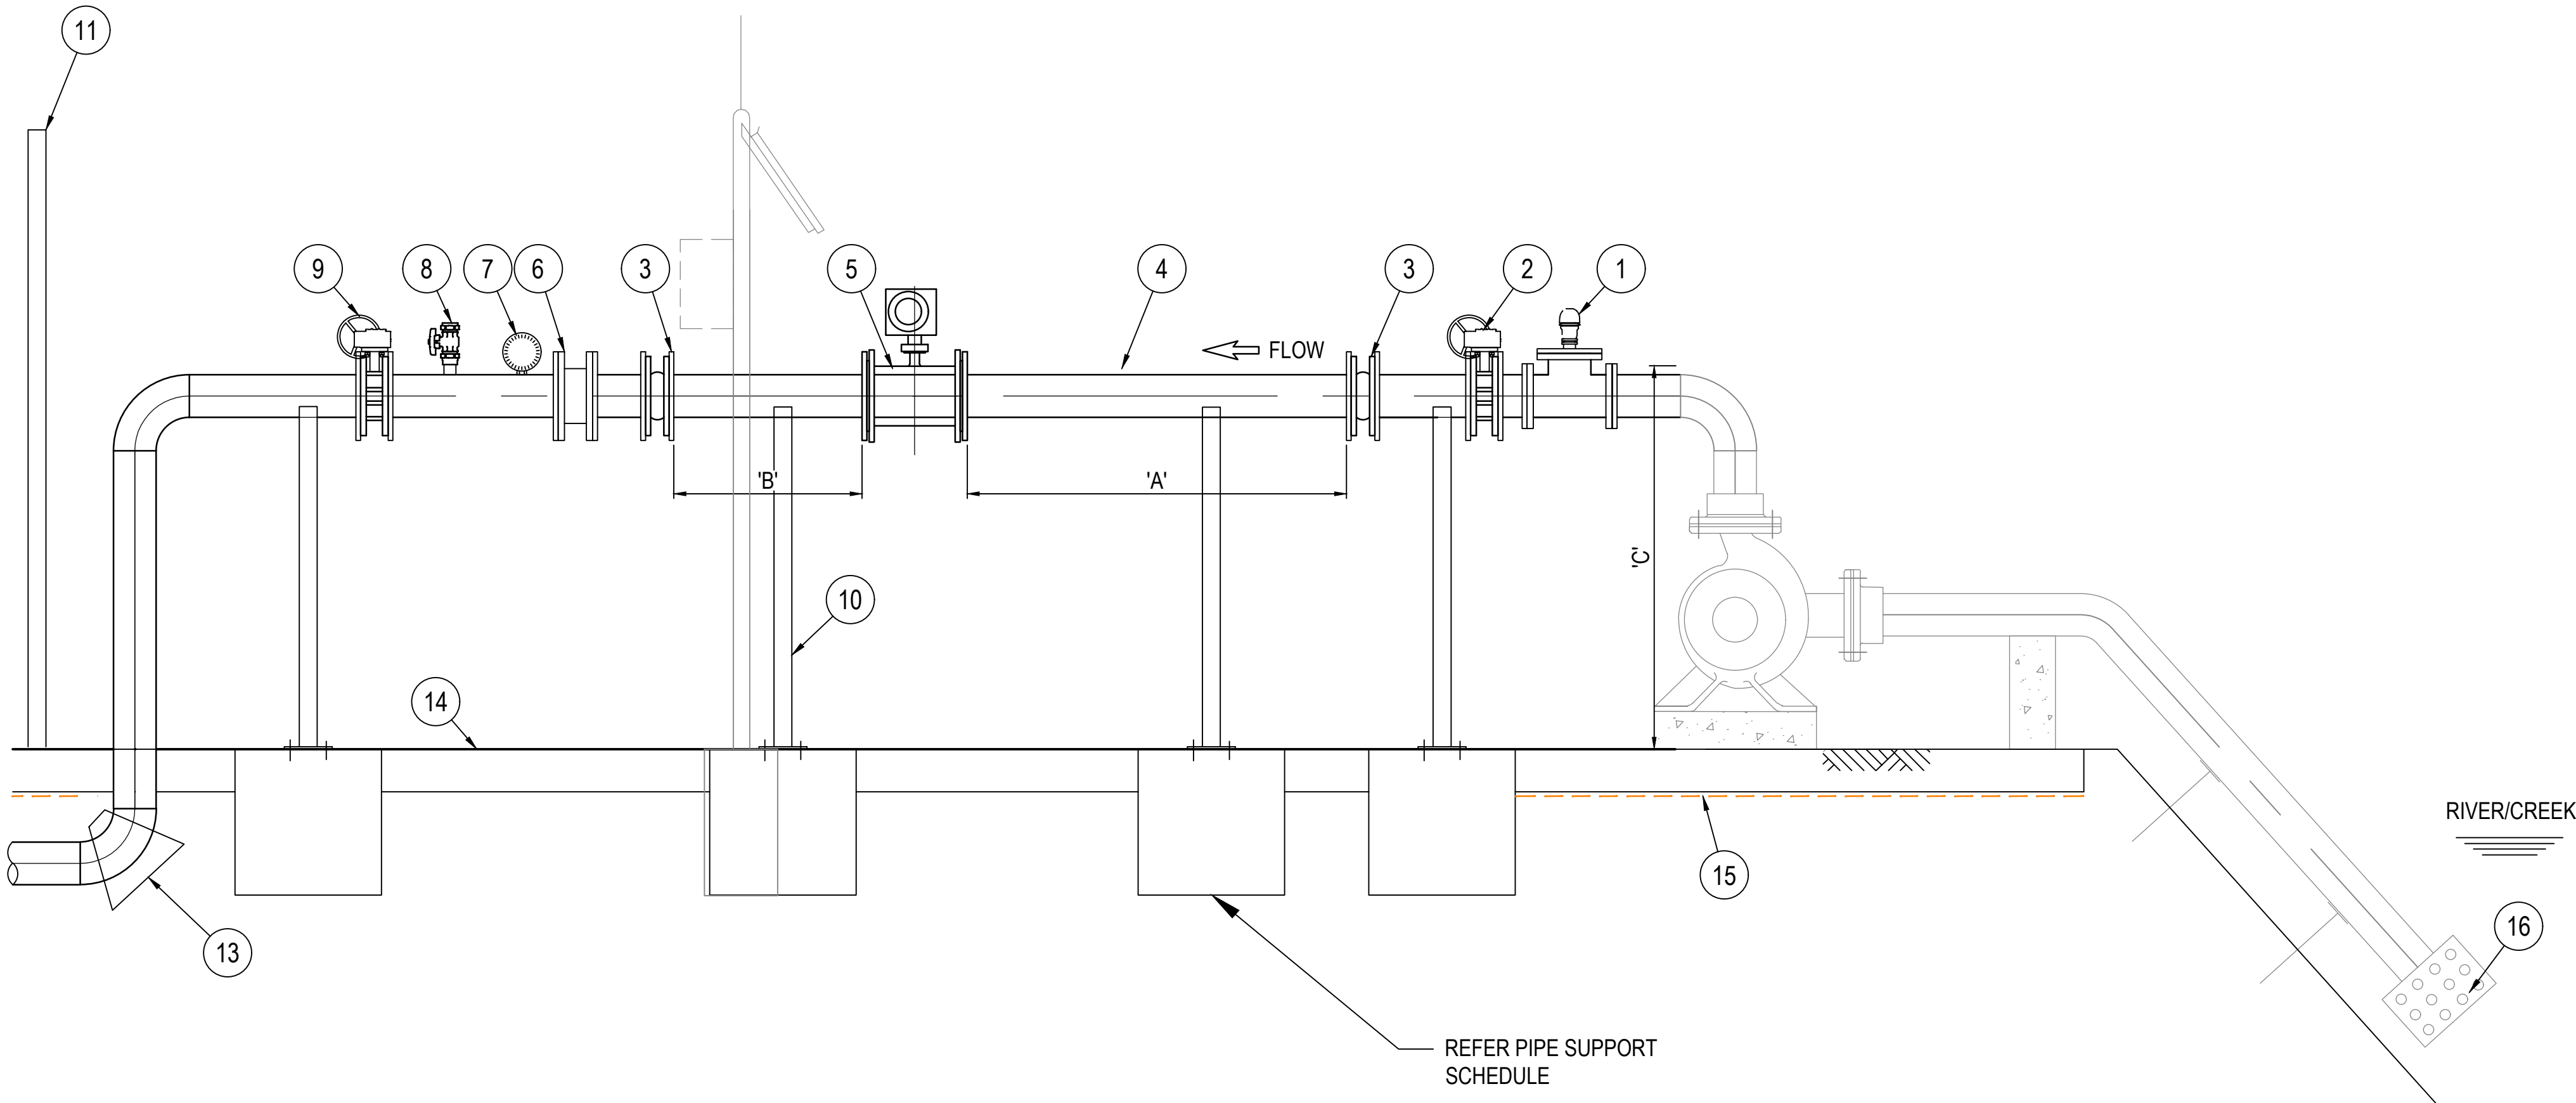

PIPE SUPPORT SCHEDULE (ABOVE GROUND)		
	Ø100-300mm PIPE	Ø301-600mm PIPE
SUPPORT MEMBER	50X5 SHS	100X5 SHS
FOOTING	Ø450 x 1000D PIER	Ø650 x 1000D PIER
MAX. SPACING	3000	4000

SURFACE WATER METER ASSEMBLY

NOT TO SCALE

NOTES:

- THE DRAWINGS AND CHECKLISTS ARE GUIDELINES ONLY AND INDICATIVE OF THE RECOMMENDED BEST-PRACTICES THAT SHOULD BE CONSIDERED DURING METER INSTALLATION. THESE DRAWINGS ARE NOT TO SCALE, AND ANY INSTALLATION WILL NEED TO BE MODIFIED TO MEET SITE CONDITIONS.
- ITEMS SHADED GREY ARE INDICATIVE ONLY AND NON-PRESCRIPTIVE
- REFER TO DRAWING 25026-CI-1007 FOR LID ASSEMBLY
- PUMP DETAILS INDICATIVE ONLY.
- STANDARD DRAWINGS APPLICABLE TO DN100 - DN600 METERS ONLY. METERS > DN600 REQUIRE SITE-SPECIFIC ENGINEERED DESIGNS.
- UNITS ARE IN MILLIMETRES U.N.O.
- RECOMMENDED PRINTING SIZE A3

MATERIALS SCHEDULE

ITEM NO.	ITEM	DESCRIPTION
1	AIR VALVE	SIZED AS REQUIRED FOR DESIGN FLOW RATE, INCLUSIVE OF ISOLATION BALL VALVE. AIR VALVE AND BALL VALVE ASSEMBLY TO BE MOUNTED ATOP A BLANK PLATED EQUAL TEE TO ADVANTAGE AIR CAPTURE.
2	UPSTREAM ISOLATION VALVE	TYPE (E.G. GATE, BUTTERFLY, BALL, GLOBE, ETC.) AS REQUIRED FOR APPLICATION. THE VALVE MUST LOCKED AT 100% OPEN DURING NORMAL OPERATION, TO MAINTAIN METER ACCURACY.
3	RUBBER FLEXIBLE JOINT	JOINT TO ELIMINATE THERMAL PIPE MOVEMENT STRESSES AND MINIMISE VIBRATION TRANSFER TO METER BODY. TYPE DETERMINED BY PIPE MATERIAL AND APPLICATION
4	PIPEWORK	STRAIGHT LENGTH OF PIPE FREE FROM DISTURBANCES (LENGTH AS PER TABLE OF DIMENSIONS). ID OF PIPE MUST EQUAL METER ID. CORROSION-RESISTANT MATERIALS INCLUDE STAINLESS STEEL, ALUMINIUM, COPPER, BRONZE AS PER SPECIFICATIONS OF AS4747.2. FLEXIBLE PIPES MAY BE USED E.G. HDPE, ABS, PVC HOWEVER THE DESIGN IS TO ENSURE THAT THE METER EMPLACEMENT AND METER ACCURACY IS NOT IMPACTED BY THERMAL EFFECTS (TEMPERATURE CHANGES OF PIPEWORK, FITTINGS AND WATER CONVEYED), AND THE METER BODY IS NOT EXPOSED TO STRESSES FROM EXPANSION/CONTRACTION OF THE SURROUNDING PIPEWORK.
5	METER	PATTERN-APPROVED METER
6	CHECK VALVE	ONE-WAY CHECK VALVE PREVENTING REVERSE FLOW AND ENSURE METER EMPLACEMENT REMAINS FULL
7	PRESSURE GAUGE	100MM DIAMETER FACE, LIQUID FILLED ANALOGUE PRESSURE GAUGE, LOCATED DOWNSTREAM OF METER EMPLACEMENT
8	INSPECTION PORT	DN50 TAPPING AND BALL VALVE INSPECTION PORT, LOCATED DOWNSTREAM OF METER EMPLACEMENT
9	DOWNSTREAM ISOLATION VALVE	TYPE (E.G. GATE, BUTTERFLY, BALL, GLOBE, ETC.) AS REQUIRED FOR APPLICATION
10	PIPE SUPPORTS	CORROSION-RESISTANT PIPE SUPPORTS DESIGNED FOR APPLICATION, MOUNTED ON SUITABLE FOOTING. NUMBER AND SPACING AS PER DESIGN
11	MARKER POST	GENERALLY CONSISTENT WITH WSAA DWG WAT-1300, BLUE OR WHITE IN COLOUR, MIN. 900MM HIGH (ABOVE-GROUND) AND CORROSION RESISTANT (350MM MIN. EMBEDMENT IN GROUND)
12	BOLLARDS	1200MM HIGH, CONCRETE FILLED, DN100 HEAVY WALL HDG STEEL PIPE PAINTED WHITE OR YELLOW. NUMBER AS REQUIRED FOR PROTECTION FROM VEHICLE THOROUGHFARE. Ø450MM, 600MM DEEP MASS CONCRETE (N20, 20MM) FOOTING
13	THRUST BLOCKS	CONCRETE THRUST BLOCKS AS PER DESIGN IN ACCORDANCE WITH WAT-1205
14	HARD STAND	200MM DEPTH OF GRAVEL E.G. 20MM FINE CRUSHED ROCK, OR MIN. 20MPa CONCRETE SLAB TO AS 3600, FOR MINIMUM 2M BEYOND METER EMPLACEMENT EXTENTS
15	MARKING TAPE	DETECTABLE, COMPLYING WITH AS 2648.1, MINIMUM WIDTH OF 100MM WITH INSCRIPTION "DANGER BURIED WATER MAIN BELOW"
16	FILTER/TRAINER/FOOTVALVE	REQUIRED TO PROTECT FLOW METER AND VALVES FROM OBSTRUCTION. TO BE SIZED ACCORDING TO SYSTEM DUTY.

TABLE OF DIMENSIONS

DIMENSION	DESCRIPTION	APPLICATION	VALUE
A	STRAIGHT PIPE LENGTH OF UNIFORM CIRCULAR CROSS SECTION, FREE FROM FLOW DISTURBANCES* - UPSTREAM OF METER	AS LONG AS PRACTICABLE BEFORE METER UNIT, IN EXCESS OF (BY APPLICATION):	
		MINIMUM	10 X METER ID
		METER EMPLACEMENT DIAMETER SMALLER THAN SURROUNDING PIPEWORK	10 X METER ID
		METER EMPLACEMENT DIAMETER LARGER THAN SURROUNDING PIPEWORK	20 X METER ID
		PIPE CHANGE IN DIRECTION (SINGLE OR MULTIPLE), BEND/S ON SAME PLANE	15 X METER ID
B	STRAIGHT PIPE LENGTH OF UNIFORM CIRCULAR CROSS SECTION, FREE FROM FLOW DISTURBANCES* - DOWNSTREAM OF METER	PIPE CHANGE IN DIRECTION (SINGLE OR MULTIPLE), BEND/S OUT OF PLANE	40 X METER ID
		METER EMPLACEMENT AFTER PUMP	30 X METER ID
		AS LONG AS PRACTICABLE AFTER METER UNIT, IN EXCESS OF (BY APPLICATION):	
		MINIMUM	5 X METER ID
		METER EMPLACEMENT DIAMETER SMALLER THAN SURROUNDING PIPEWORK	5 X METER ID
C	METER EMPLACEMENT CLEARANCE	METER EMPLACEMENT DIAMETER LARGER THAN SURROUNDING PIPEWORK	5 X METER ID
		PIPE CHANGE IN DIRECTION (SINGLE OR MULTIPLE), BEND/S ON SAME PLANE	5 X METER ID
		PIPE CHANGE IN DIRECTION (SINGLE OR MULTIPLE), BEND/S OUT OF PLANE	5 X METER ID
		METER EMPLACEMENT AFTER PUMP	5 X METER ID
		MINIMUM CLEARANCE FROM GROUND LEVEL TO UNDERSIDE OF PIPE	MIN. 600MM
D	METER EMPLACEMENT DEPTH OF COVER	DEPTH OF COVER TO TOP OF METER EMPLACEMENT PIPE & METER	MIN. 600MM
* DISTURBANCES INCLUDE: VALVES, VALVES PARTIALLY OPENED, THROTTLING DEVICES, FLOW STRAIGHTENERS, SCREENS, T & Y JUNCTIONS, CHECK VALVES, BENDS (SINGLE OR MULTIPLE: IN AND OUT OF PLANE), PUMPS, TAPPINGS, CHANGES IN DIAMETER, PROTRUSIONS INTO THE INTERNAL PIPEWORK E.G. WELD BEADS, GASKETS, MISALIGNED FITTINGS/JOINTS, TAPPINGS, PROBES, ETC.			

©2025 State of NSW and Department of Climate Change, Energy, the Environment and Water.

DCCEEW has compiled these standard diagrams for metering equipment (**Diagrams**) in good faith, exercising all due care and attention, to assist duly qualified persons and meter installers. No representation is made about the accuracy, completeness or suitability of the information for the context in which these Diagrams are used. DCCEEW will not be liable for any loss or claim, including any death or injury to people, loss of income, penalties or damage to property arising from the use of these Diagrams to install metering equipment or otherwise. Users of the Diagrams should seek appropriate advice for their specific needs, or those of their customers, when using the Diagrams.

© 2025 Crown in right of the State of NSW acting through the Department of Climate Change, Energy, the Environment and Water (DCCEEW). These Diagrams may be reproduced, adapted and distributed by third parties in accordance with the terms of the CC-BY-NC international creative commons licence version 4.0. Details of these licence terms are available at <https://creativecommons.org/licenses/by-nc/4.0/>. In accordance with this licence, users may not charge any commercial fee when further distributing these Diagrams to third parties, must indicate clearly if the Diagrams have been modified, must attribute DCCEEW as copyright owner, and must retain these Terms of Use in full on all copies of these Diagrams.



Client DEPARTMENT OF CLIMATE CHANGE, ENERGY, THE ENVIRONMENT & WATER

Project NON-URBAN WATER METERING - STANDARD DESIGNS

Status

AN INSTALLATION GUIDE FOR
DEMONSTRATION PURPOSES

Title SURFACE WATER METER ASSEMBLY
GENERAL ARRANGEMENT PUB25/504

Drawing Number

25026-CI-1002

Revision

A

A	31/01/25	FOR INFORMATION
Rev.	Date	Description